



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

## NOTICE OF ACCEPTANCE (NOA)

---

**Therma-Tru Corporation**  
108 Mutzfeld Road  
Butler, IN 46721

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION:** Series "Construction & Premium" Flush Outswing Insulated Steel Double Door

**APPROVAL DOCUMENT:** Drawing No. **B0093**, titled "6/0 x 8/0 Steel Outswing Double Door", sheets 1 through 3 of 3, prepared by manufacturer, dated 11/21/95 with revision on 6/7/99, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING:** Large and Small Missile Impact

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 99-0311.03** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No 02-0805.07  
Expiration Date: October 3, 2007  
Approval Date: September 5, 2002  
Page 1

REV	DESCRIPTION	DATE
0	REVISED PER BCCD	6-7-99

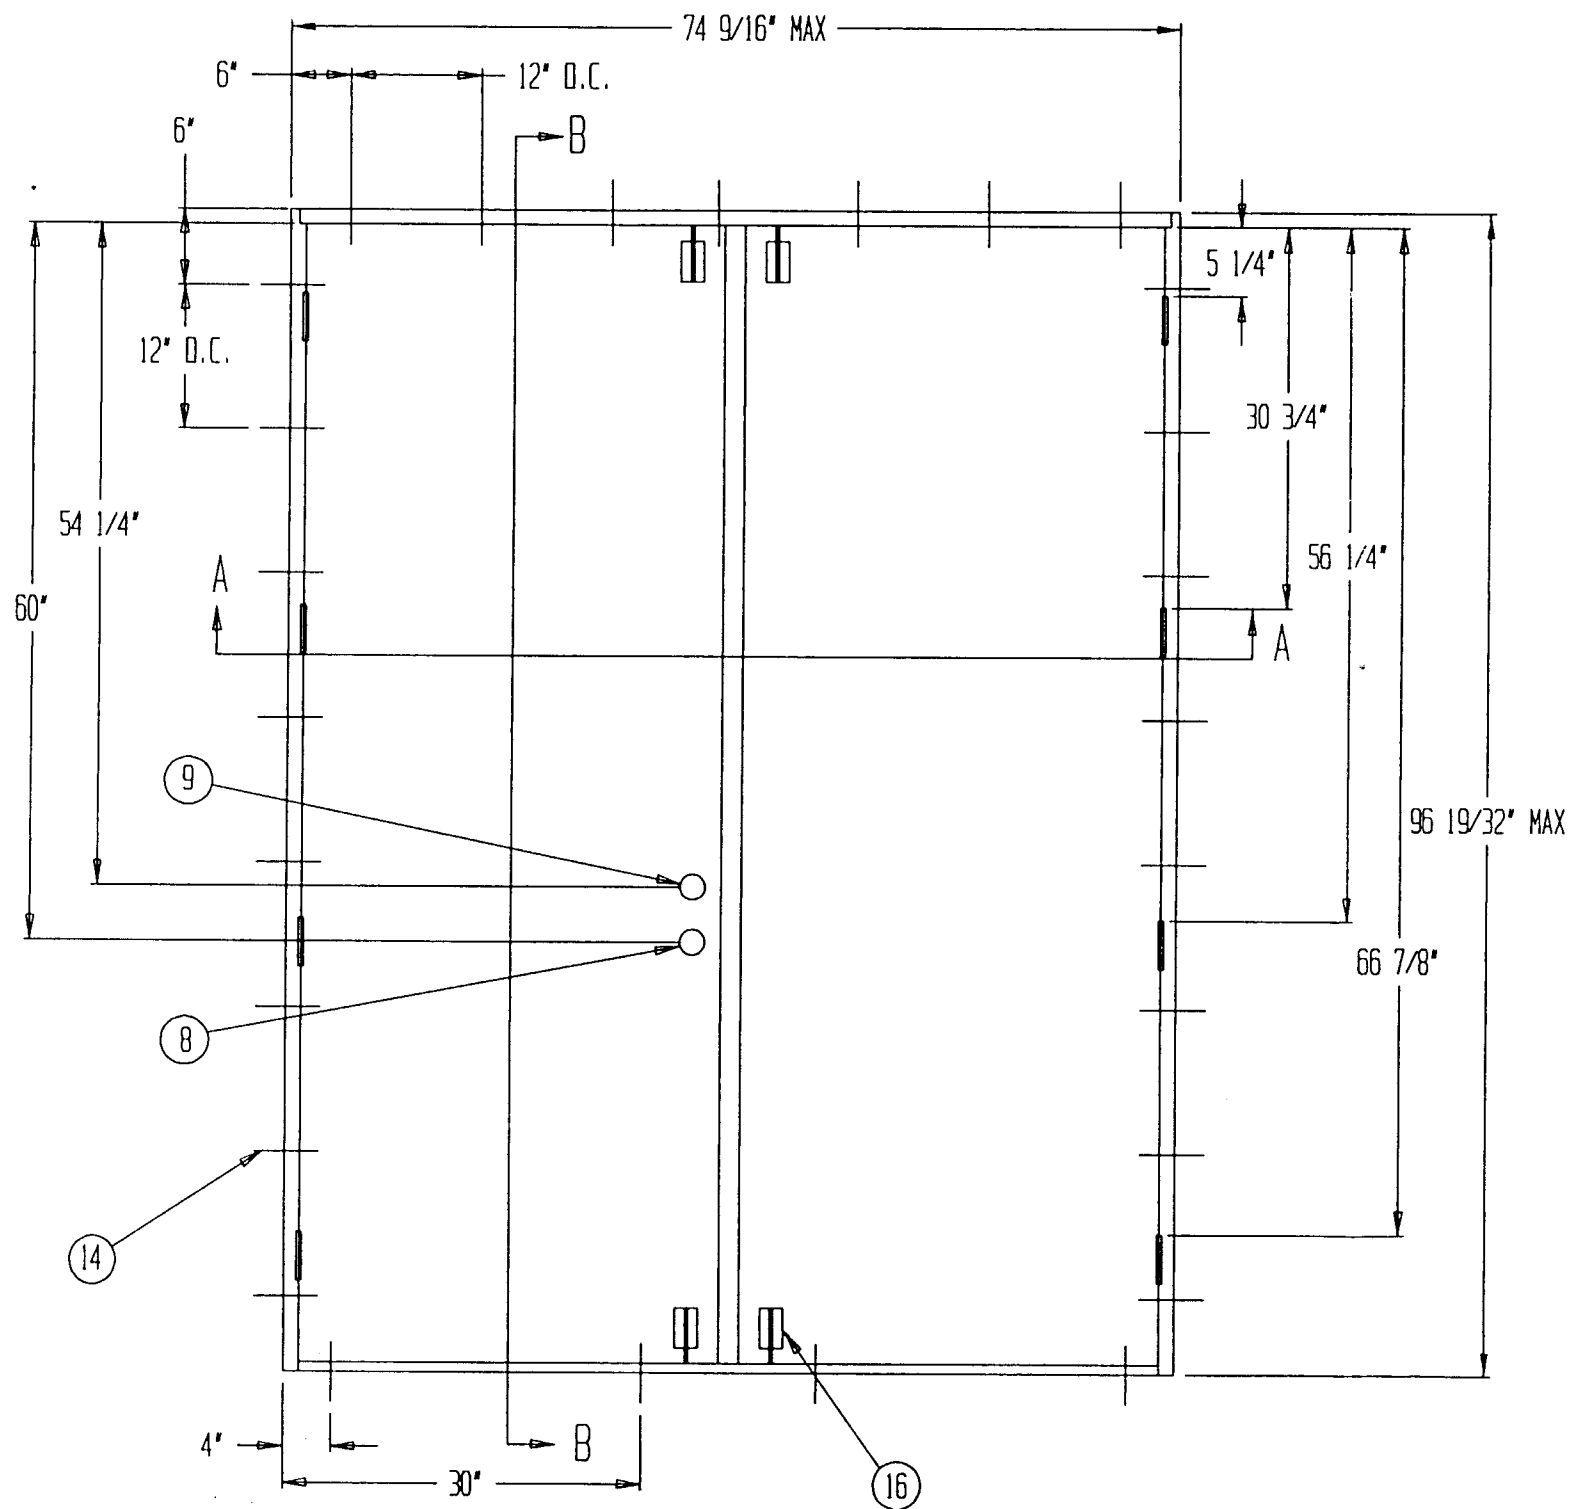

UNIT INSTALLATION  
INTERIOR VIEW  
CONFIGURATION: XX

DESIGN PRESSURE RATING	
POSITIVE	+ 49.2 psf
NEGATIVE	- 65.6 psf

18	1	SINGLE LEAF PLASTIC STRIP
17	27	3/16" X 3" TAPECON
16	4	SURFACE MOUNTED SLIDE BOLTS, 5/8" X 6" BOLT W/1" THROW MOUNTED ON SPACER BLOCK FASTENED W/(2) #8 X 2" FHWS
15	10	2 1/2" STAPLES
14	27	#10 X 3" SCREWS
13	AS REQD	SEALANT
12	1	EXTRUDED ALUMINUM ASTRAGAL SECURITY COVER
11	1	ASTRAGAL W/COMPRESSION WEATHERSTRIP AND FLUSH BOLTS
10	8	4' X 4' THERMA-TRU BRAND SELF-LOCATING HINGES SECURED W/4 #10 X 2 1/2" FHWS (2 TOP - 1 CENTER AND BOTTOM) AND 8 #10 X 3/4" FHWS
9	1	KVIKSET 660 SERIES DEAD BOLT OR SCHLAGE SERIES B160
8	1	KVIKSET 200 SERIES LOCK SET OR SCHLAGE SERIES F
7	1	ALUMINUM OUTSWING SILL W/ BUMPER SEAL
6	AS REQD	THERMA-TRU BRAND COMPRESSION WEATHERSTRIP
5	3	4 9/16" X 1 1/4" FINGERJOINTED PINE JAMBS & HEADER KERFED 1/8" X 1/2" FOR COMPRESSION WEATHERSTRIP
4	4	15/16" WOOD/COMPOSITE END RAILS
3	4	1 1/4" X 1 11/16" PINE STILES
2	AS REQD	POLYURETHANE FOAM (BASF P10160R/P1038U), DENSITY=2.1 PDF
1	4	FLUSH OR EMBOSSED GALVANIZED STEEL, .018" THICK MIN.; YIELD STRENGTH: Fy=31,500 psi
ITEM	QTY	DESCRIPTION

BILL OF MATERIAL







THERMA-TRU CORPORATION

TITLE: 6/0 X 8/0 STEEL OUTSWING DOUBLE DOOR

DRAWN BY:	DATE:	SCALE:	DRAWING NO.:	REV:	SHEET:
R.F.	11-21-95	NONE	B0093	0	1 OF 3

PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Acceptance No 02-0805.07  
Expiration Date 02-31-2007  
By *Manuel Perez*  
Miami Dade Product Control  
Division

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE *August 12* 1999  
BY *Isiah Lechanda* ...  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. *99-0311-03*

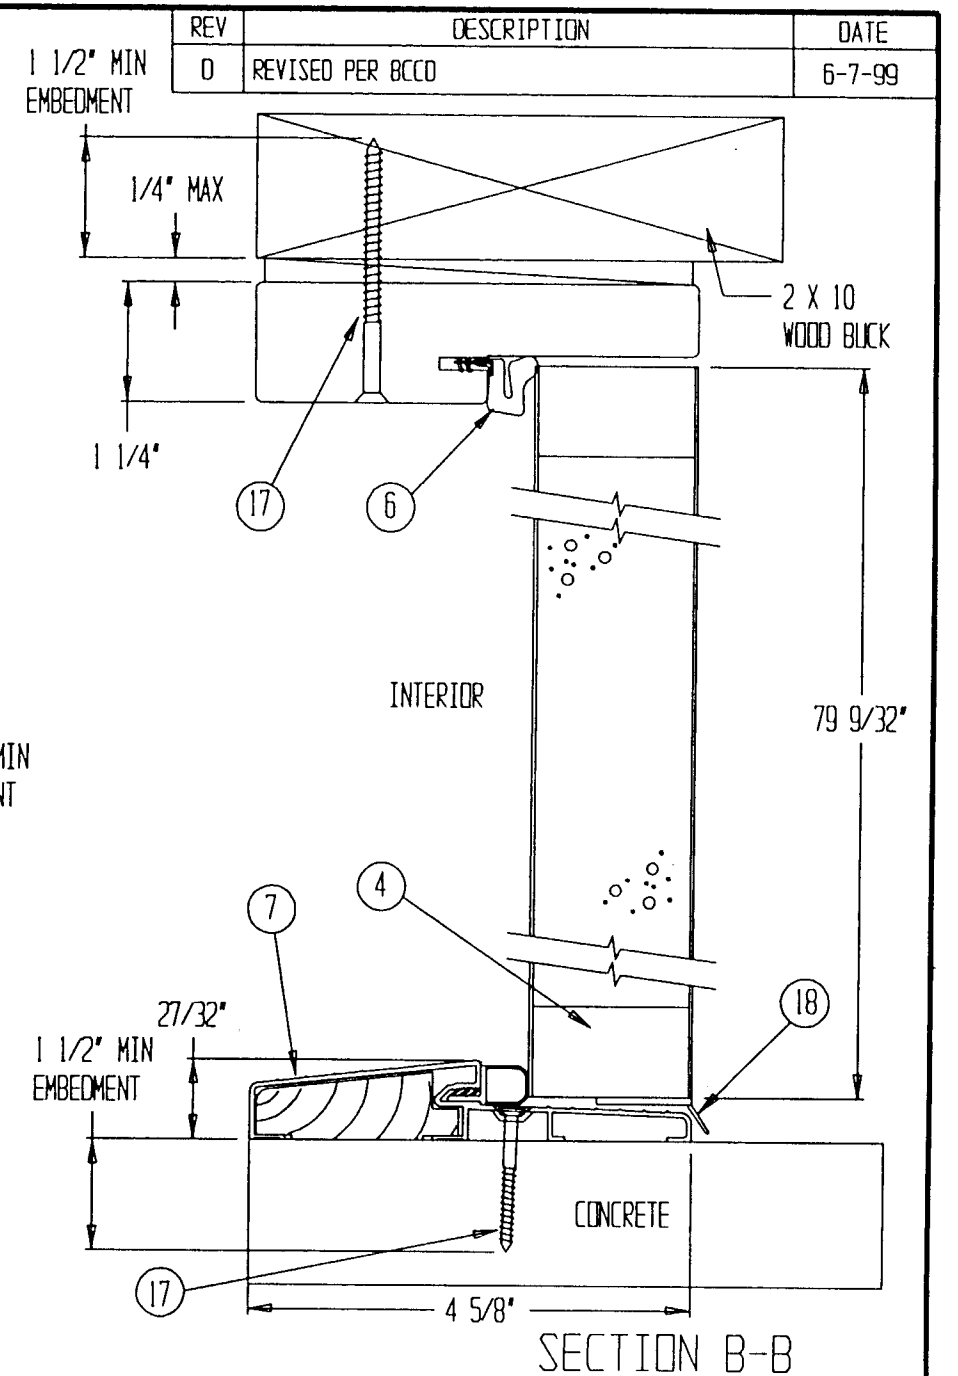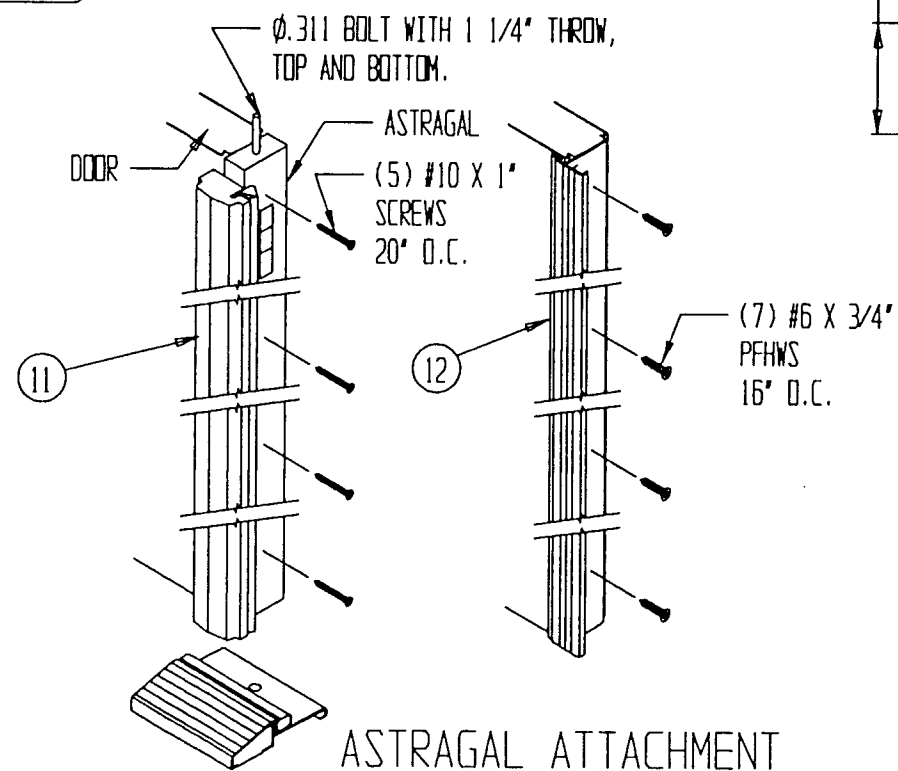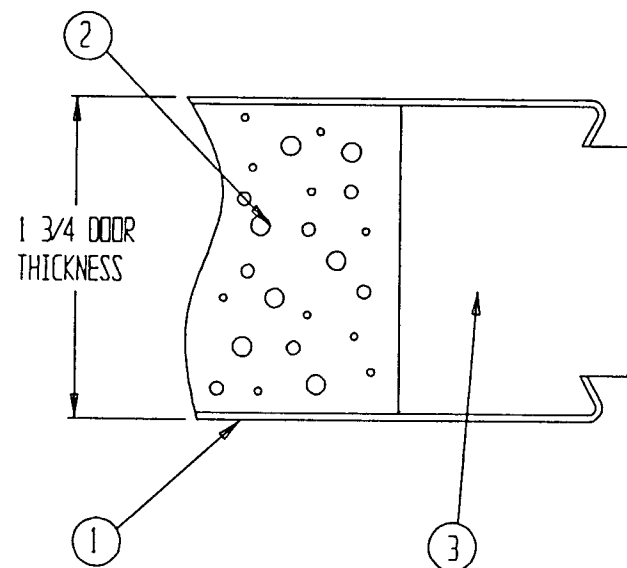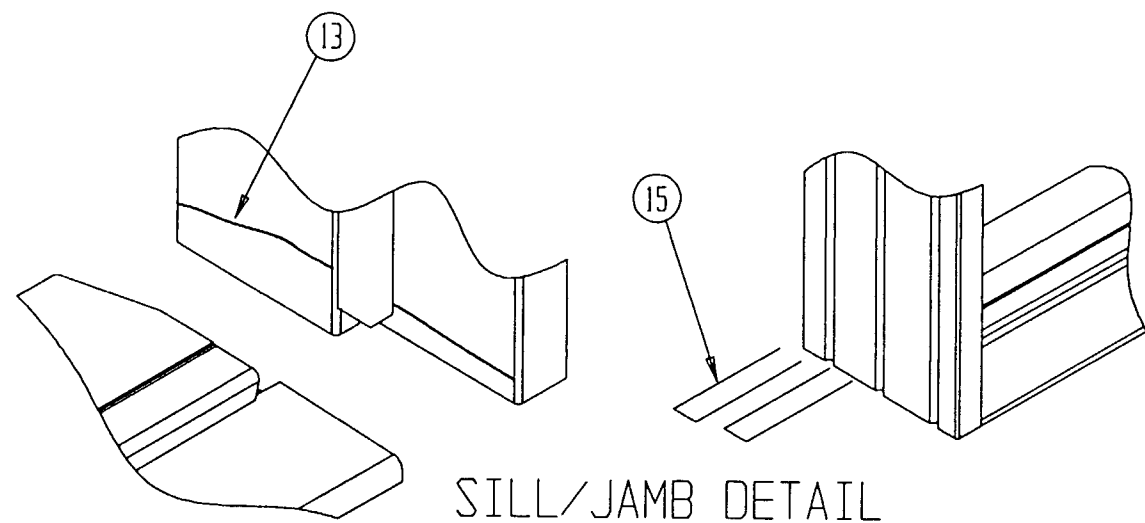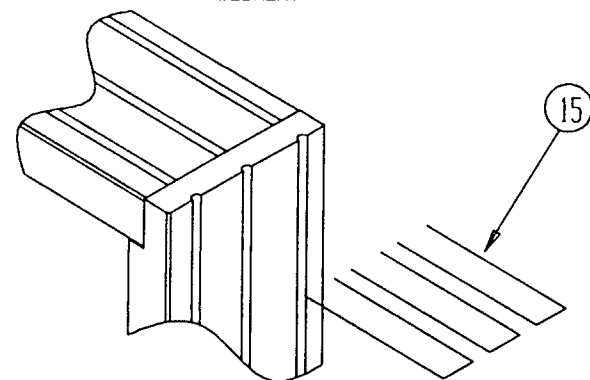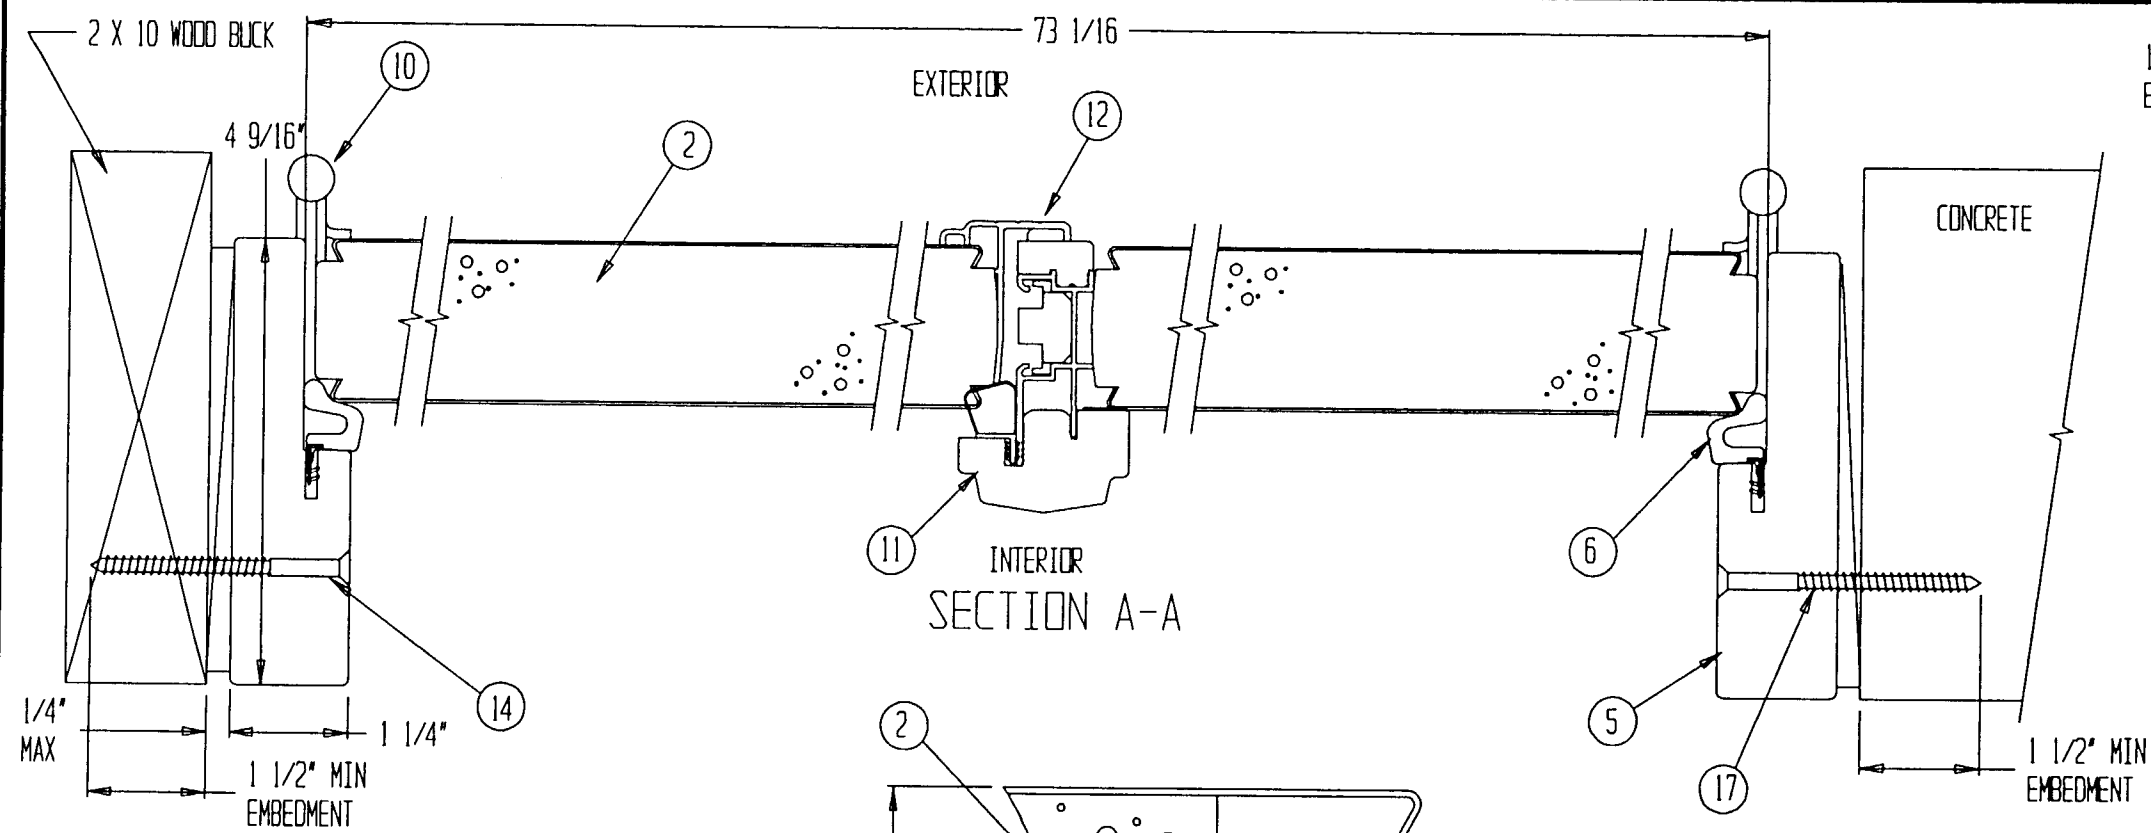

REV		DESCRIPTION		DATE	
0		REVISED PER BCCO		6-7-99	


  

TITLE: 6/0 X 8/0 STEEL OUTSWING DOUBLE DOOR					
DRAWN BY: R.F.	DATE: 11-21-95	SCALE: NONE	DRAWING NO.: 80093	REV: 0	SHEET: 2 OF 3

<b>PRODUCT RENEWED</b> as complying with the Florida Building Code Acceptance No 02-0805.07 Expiration Date Oct 3, 2007 By <i>Maurice Jara</i> Miami Dade Product Control Division	APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>August 12, 1999</u> BY <u>Ishaq I. Chaudhry</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>99-0311.03</u>
---	--

REV	DESCRIPTION	DATE
0	REVISED PER BCCD	6-7-99

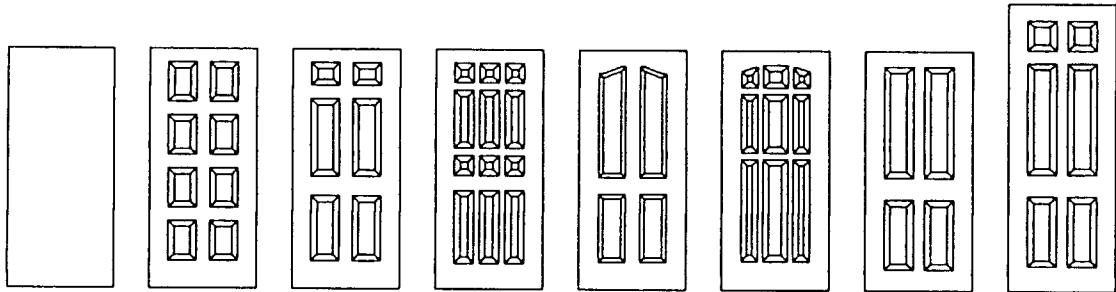

FLUSH/EMBOSSED SLAB OPTIONS

<div>THERMA-TRU CORPORATION</div>					
<div>TITLE: 6'0 X 8'0 STEEL OUTSWING DOUBLE DOOR</div>					
<div>DRAWN BY: R.F.</div>	<div>DATE: 11-21-95</div>	<div>SCALE: NONE</div>	<div>DRAWING NO.: B0093</div>	<div>REV: 0</div>	<div>SHEET: 3 OF 3</div>
<div>           PRODUCT RENEWED            as complying with the Florida            Building Code            Acceptance No. 02-0805-07            Expiration Date Oct 3, 2007            By <i>[Signature]</i>            Miami Dade Product Control            Division         </div>			<div>           APPROVED AS COMPLYING WITH THE            SOUTH FLORIDA BUILDING CODE            DATE: August 12, 1999            BY: Ishay I. Chanda            PRODUCT CONTROL DIVISION            BUILDING CODE COMPLIANCE OFFICE            ACCEPTANCE NO. 99-0311-03         </div>		